


TABLOU ELECTRIC TDG-T (Corp E) 400/230V, 50Hz

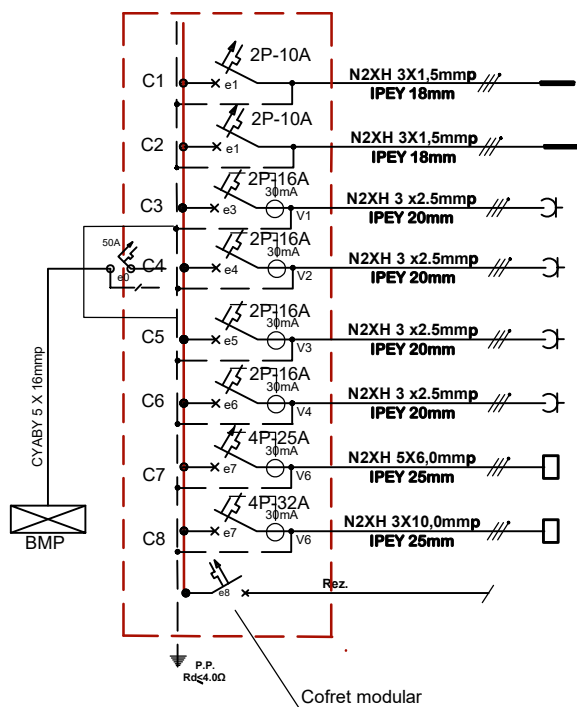

nr. rec.	PI [kW]	destinatie
11LL	0.80	circ. ilum. parter
17L	0.90	circ. ilum. parter
5LP	1,50	prize monofazate parter
8LP	2,00	prize monofazate parter
7LP	2,00	prize monofazate parter
6LP	1.80	prize monofazate parter
TE-S	16,00	circ. alimentare TE-S
TE-E	9,00	circ. alimentare TE-E
1LF	2,30	circ. alimentare presa de calcat

$P_i = 34,000 \text{ KW}$
 $P_a = 22,00 \text{ KW}$
 $C_s = 0,70$
 $U = 400/230V$
 $f = 50 \text{ Hz}$
 $I_c = 41,80A$

Lista aparataj:

- eo - intrerupator tripolar 32A, 400V, 50Hz,
- e1,e2- disjunctur bipolar 10A, 230V, 50Hz, cu protectie diferentiala
- e3, e4, e5, e6- disjunctur bipolar 16A, 230V, 50Hz,
- e7- disjunctur tripolar 32A, 400V, 50Hz,
- e8- disjunctur bipolar 32A, 230V, 50Hz, cu protectie diferentiala