


TABLOU ELECTRIC TE- SP (Corp F Spalatorie)

380/230V, 50Hz

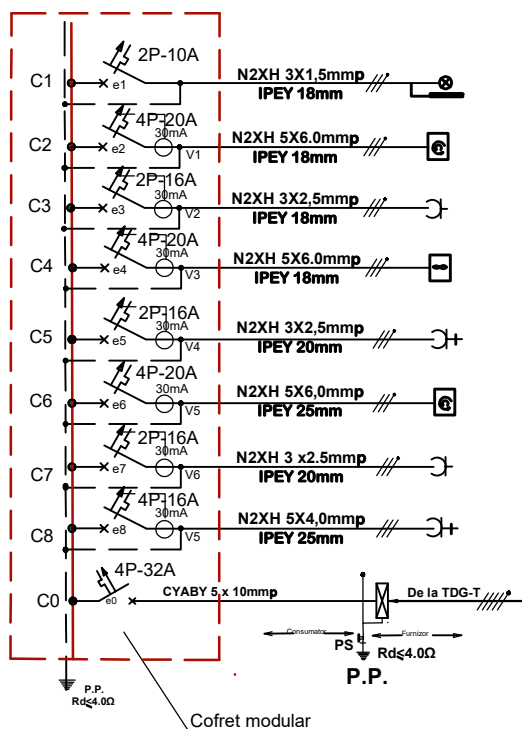

nr. rec.	PI [kW]	destinatie
3LL	0,500	circ. ilum.
1LF	7,50	circ. pentru MSV
1LP	0,50	circ. prize monofazate frigider
1LF	7,10	circ. uscator
1LP	0,50	circ. priza
1LF	7,10	circuit storcator
1LP	0,50	circ. priza normala
1LF	2,30	circ. alimentare presa de calcat

Pi = 27,00 KW

Pa = 19,00 KW

Cs = 0,70

U= 400/230V

f= 50 Hz

Ic= 30.50A

Lista aparataj:

- eo - intrerupator tripolar 32A, 400V, 50Hz,
- e1- disjunctori bipolar 10A, 230V, 50Hz,
- e2, e4, e6 - disjunctori 20A, 400V, 50Hz,
- e3, e5, e7, e8 - disjunctori tripolari 16A, 400/230V, 50Hz

Nota :

LF- Loc forta